



# WEST FARGO FIRE DEPARTMENT

106 1st St W • West Fargo, ND 58078  
Phone: 701-515-5600 • Fax: 701-515-5601



## Flammable / Combustible Liquids Permit Requirements

Permits as authorized by 2018 International Fire Code and 2018 NFPA

A permit is required for all storage/dispensing of flammable and combustible liquids inside and/or outside of structures that are over qty limits stated in the International Fire Code.

Permit applications shall be completed with fees associated.

.....

**Planning and Zoning of West Fargo shall be notified by applicant prior to submission of application @ 701-515-5373**

Additional information included with application are as follows:


- Site Plan of property in its entirety:
  - Lot Size
  - Buildings associated
  - Distances associated with install location (sidewalks, property lines, structures, dispenser unit, etc.)
- Type of liquid
- Total amount
- Listing of tank/dispenser with manufacture paperwork (UL listing, etc.)

**After review of permit application, the applicant will be notified of approval or denial within 2 weeks of receiving the application.**

- If approved, the installation can be planned.
- A fire inspection shall be completed after testing and work has been completed. At this time a permit will be issued.

**NO FUEL shall be added until permit has been issued.**

12th St N

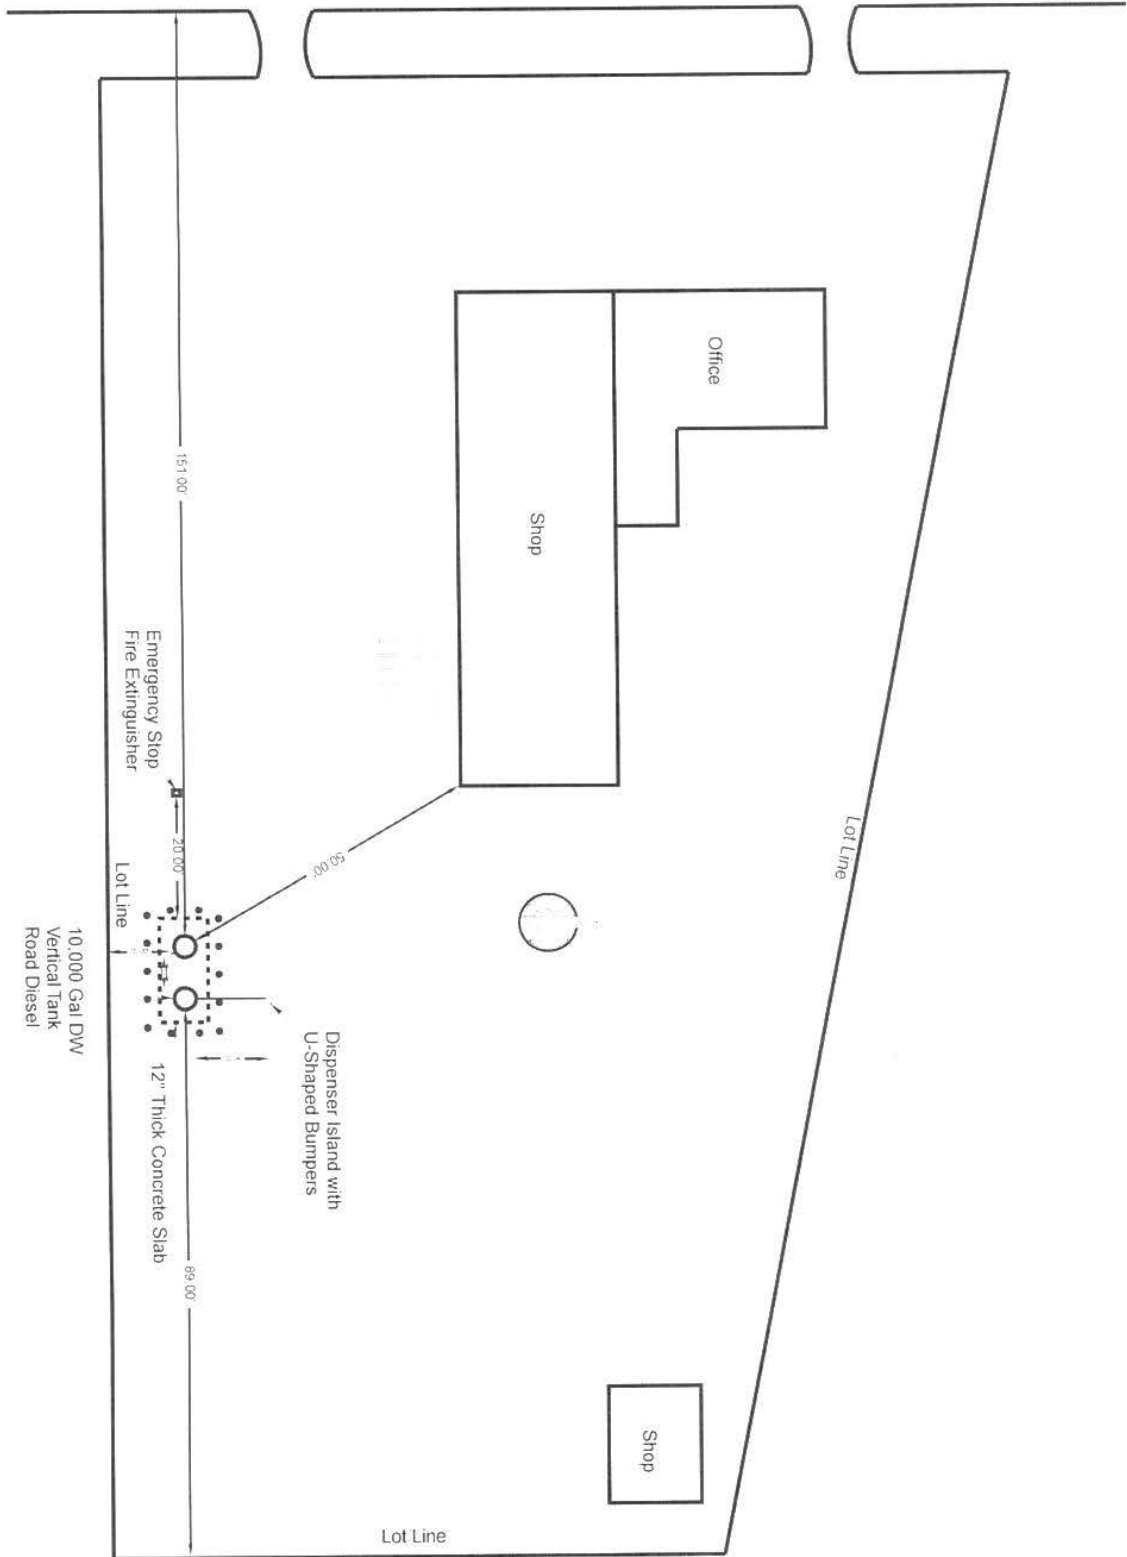

Emergency Stop  
Fire Extinguisher

Lot Line

10,000 Gal DW  
Vertical Tank  
Road Diesel

12" Thick Concrete Slab

Dispenser Island with  
U-Shaped Bumpers

Shop

Office

Lot Line

Shop

Lot Line

